

CONDAIR RH CONNECT MAINTENANCE CHECKLIST



Technician:

Customer:

Date:

Serial No.:

Order No.:

Water quality

Potable water:

Conductivity: 125-1250 $\mu\text{S/cm}$

Pressure: 30-80 psig (2-5.5 bar)

Water hardness:

gpg

Temperature: 39-88 °F (4-30 °C)

Check: Cleaning or replacement


Steam connection part (1)

Filling cup set (2)

Condensate hose (replace after 3 years if applicable)

Tighten
hose clamp (x2)
Steam Hose
(replace after 15,000 h)

Steam outlet adapter
(replace after 3 years if required)

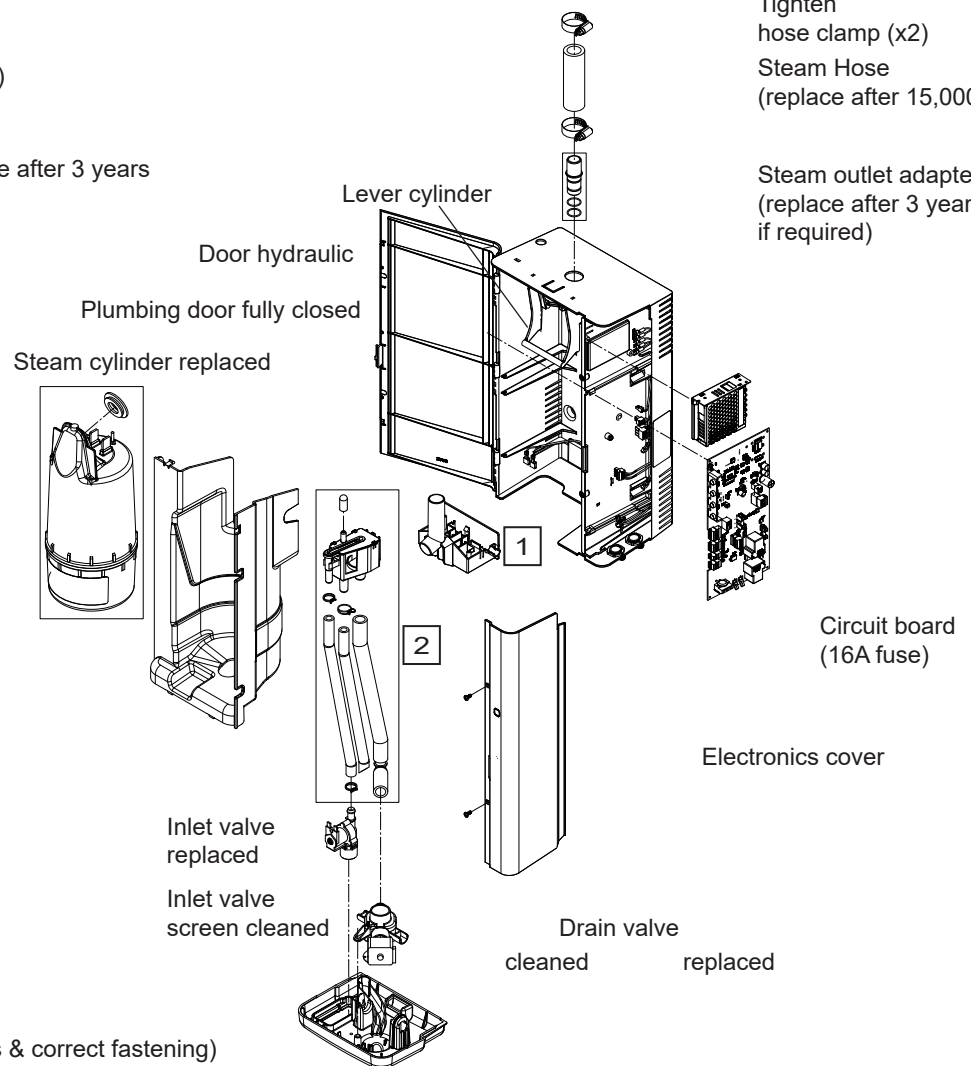

Inspection

Steam installation (cracks & correct fastening)

Water installation (cracks & correct fastening, inlet pipe sealed, water filter cleaning)

Electrical installation (Cables: secure fitting & insulation)

Safety components (safety On/Off high limit humidistat, air proving switch, humidity sensor)

Device parameters on service portal app

Mobile App

Reset maintenance status & operating hours

Operating hours:

Comments: