



**In-Duct High Pressure Nozzle
Humidification System
HP HVAC Series
Submittal Drawings**

Date:

Job Name:

Contractor:

Contractor or Order No.:

Engineer:

Agent:

Agent P.O. No.:

Date Ordered:

Date Required:

Condair (USA) Inc.

2700 90th Street, Sturtevant, WI 53177 Tel: 262.884.4669



Condair (Canada) Ltd.

2740 Fenton Road, Ottawa, ON K1T 3T7 Tel: 613.822.0335

1-866-667-8321



Email: na.info@condair.com

Fax: 613.822.7964

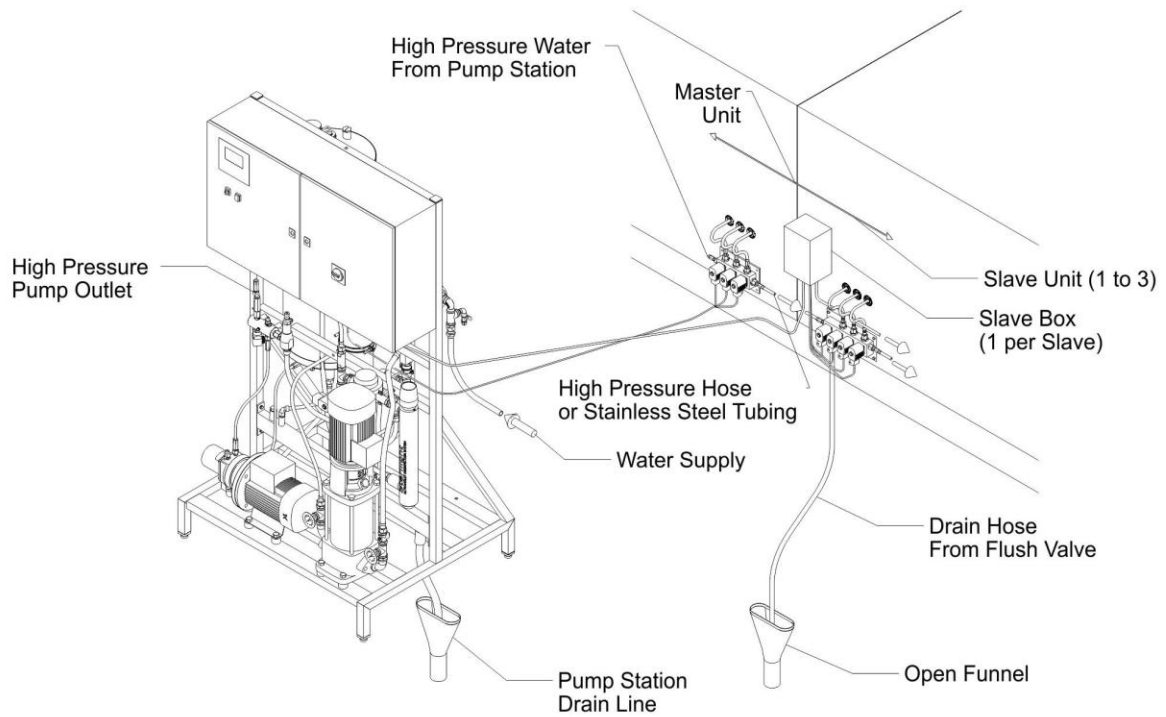
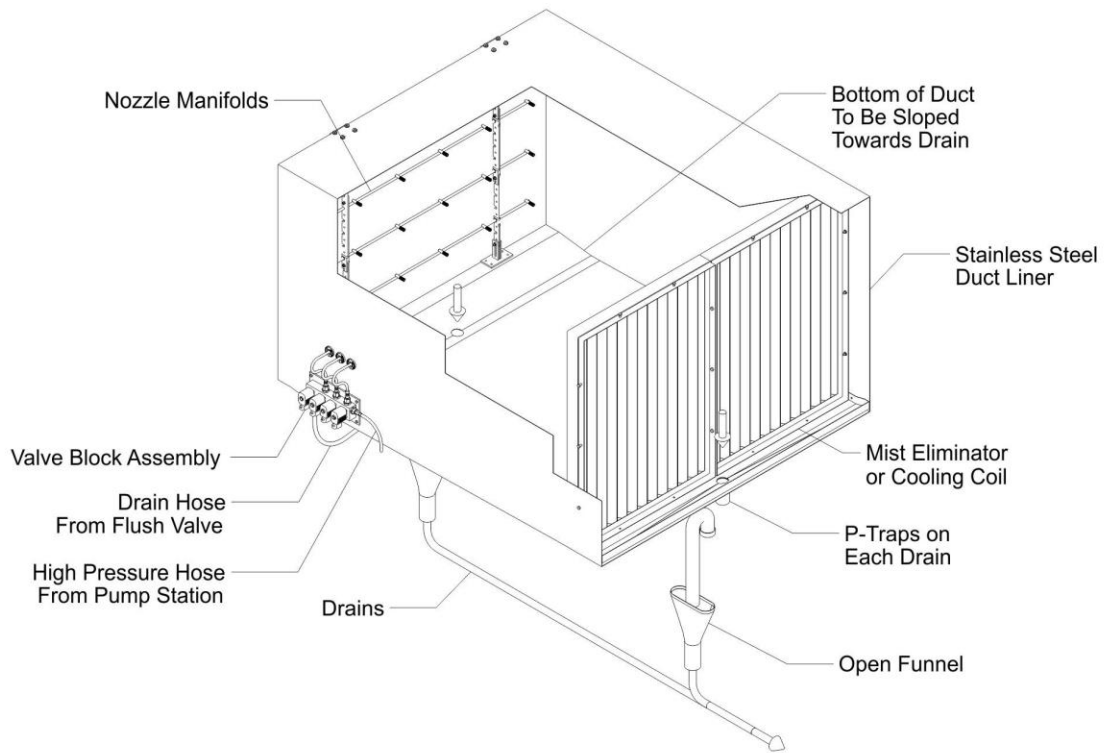


HP Series
 HP General Installation
 December, 2018


Water Inlet (RG 3/4")
(1/2" or 3/4" Barb Fitting
Provided)

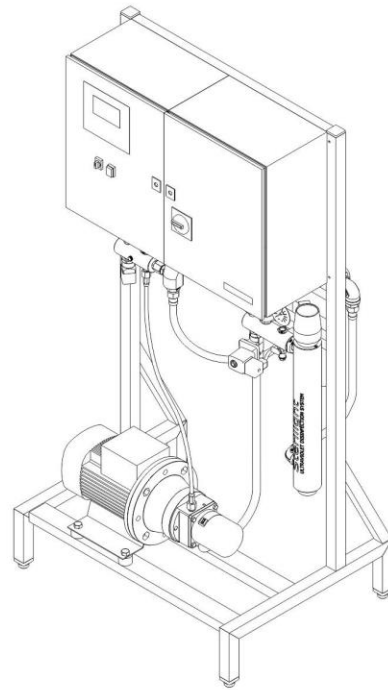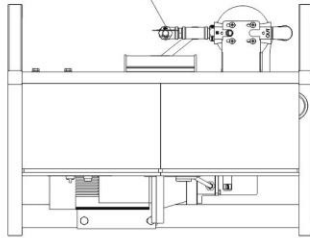


HP Outlet
(Use Supplied Hose)

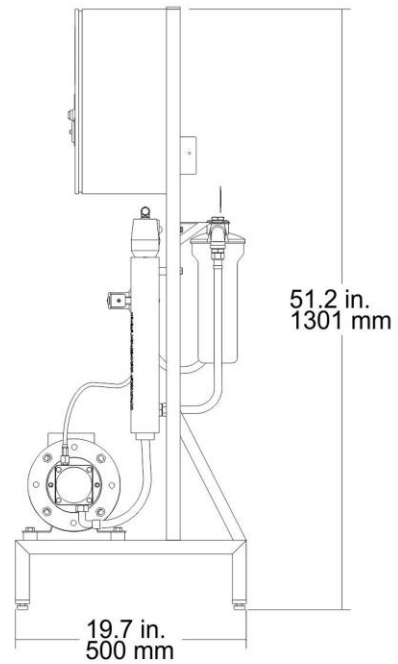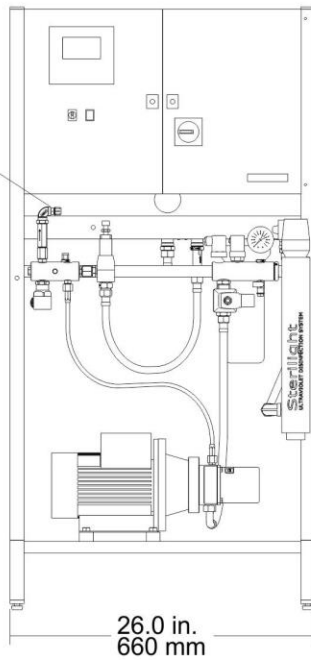

HP Series - HP 100, 200VFD, 300,
500, 500VFD, 800, 800VFD, 1300VFD
December, 2018

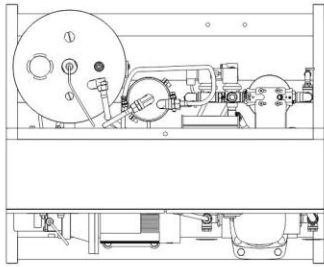


HP Outlet
(Use Supplied HP Hose)

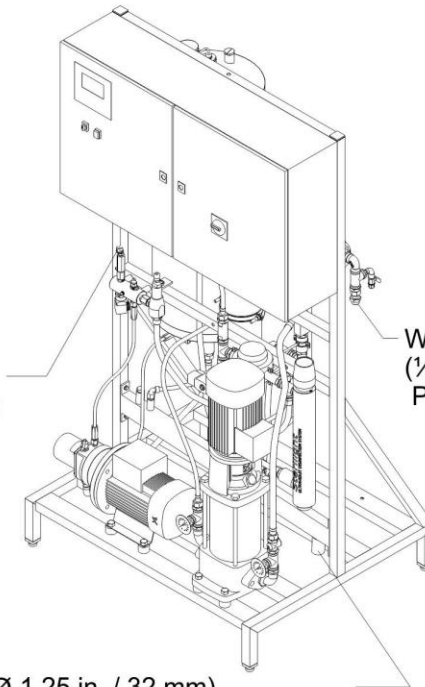


Water Inlet (RG 3/4")
(1/2" or 3/4" Barb Fitting
Provided)

Drain Connector (Ø 1.25 in. / 32 mm)
Min. Diameter of Drain Hose: Ø 1.60 in. / 40 mm

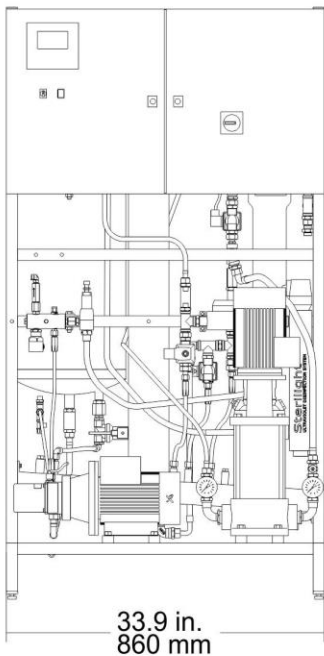

33.9 in.
860 mm



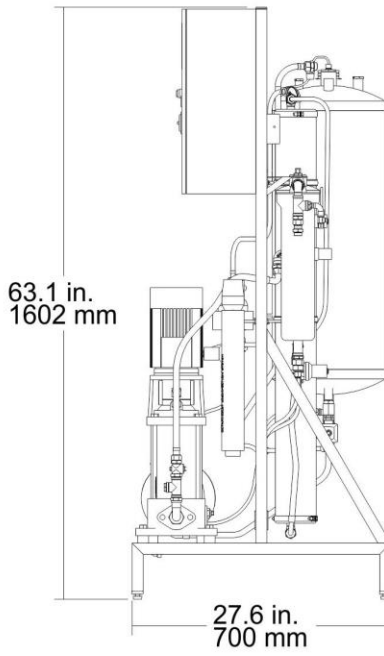


63.1 in.
1602 mm





27.6 in.
700 mm



HP Series - HPRO
100, 200VFD, 300, 500, 500VFD
December, 2018

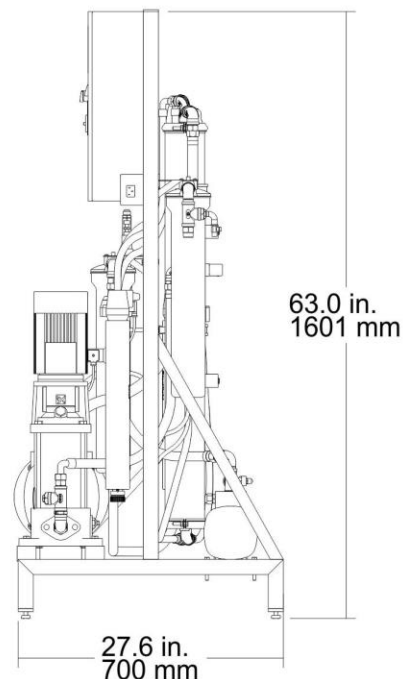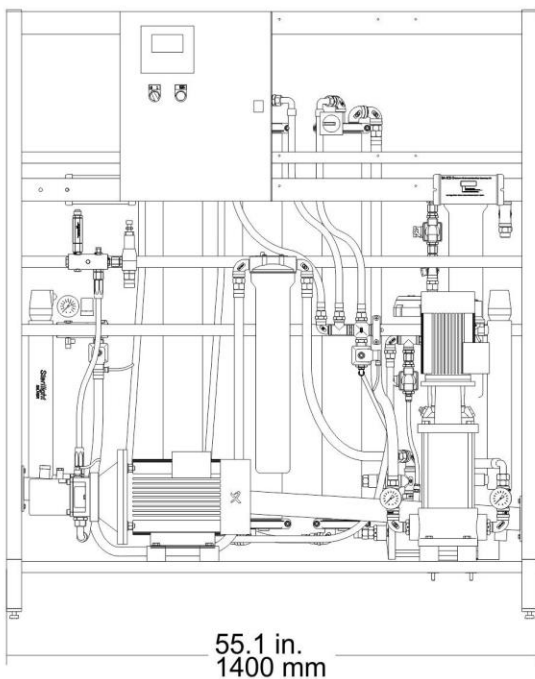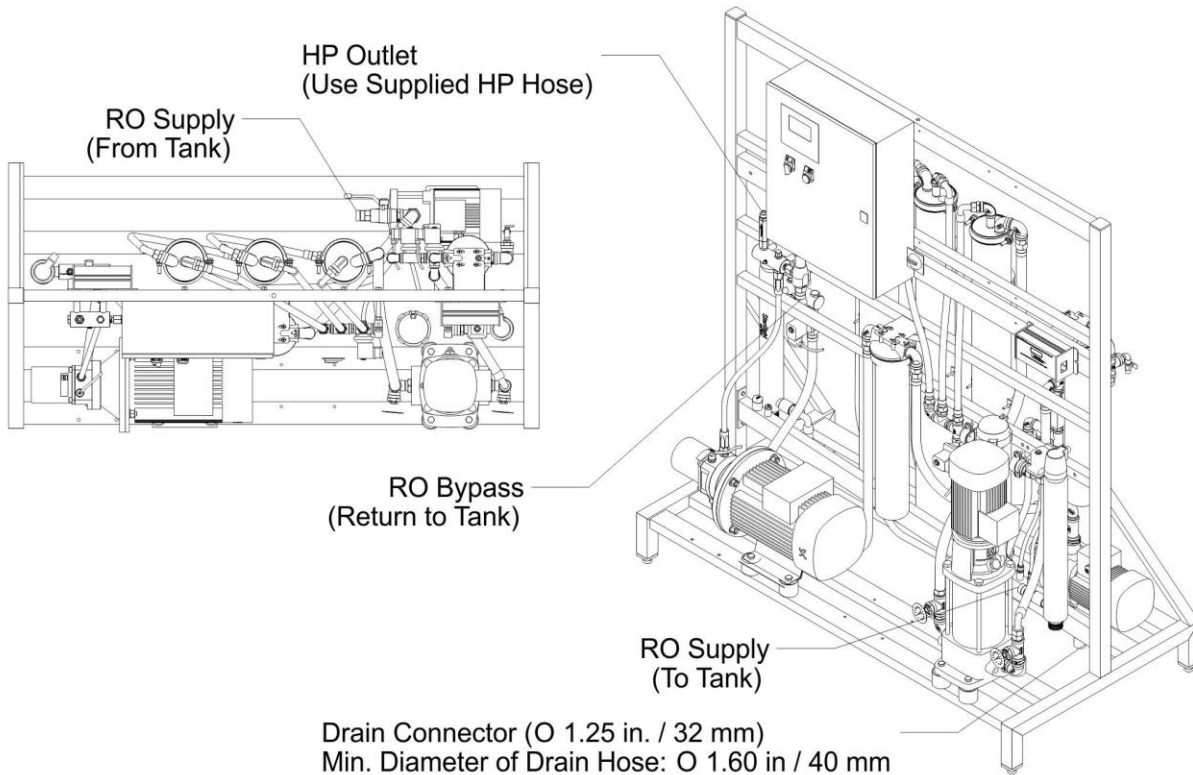

HP Series - HPRO
HPRO 800, HPRO 800VFD
December, 2018

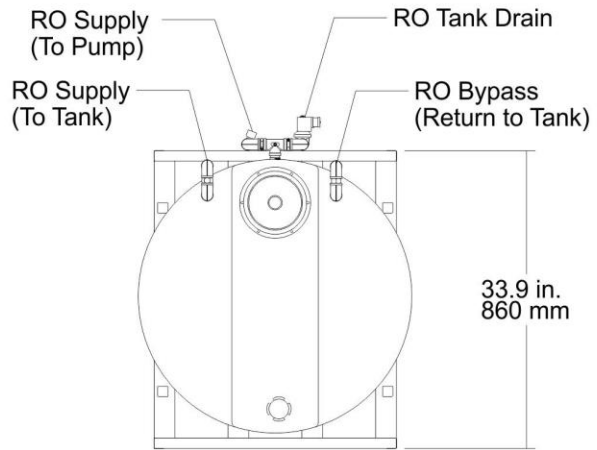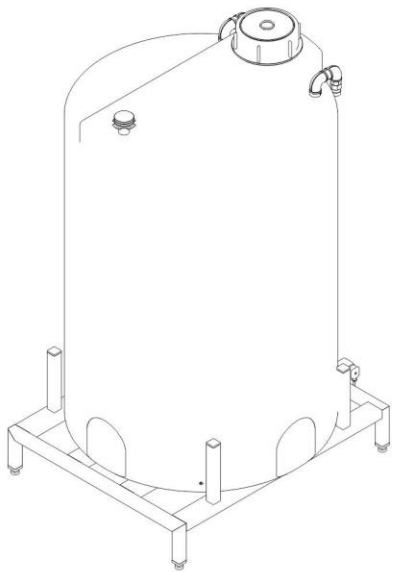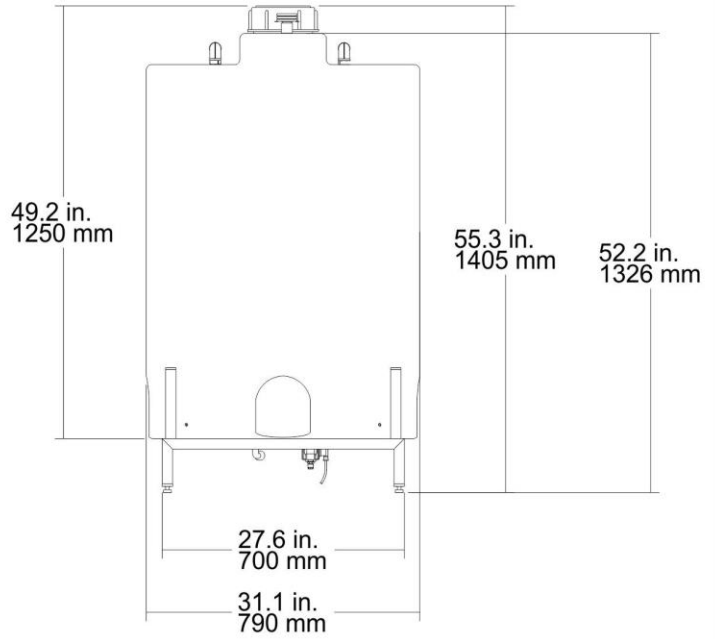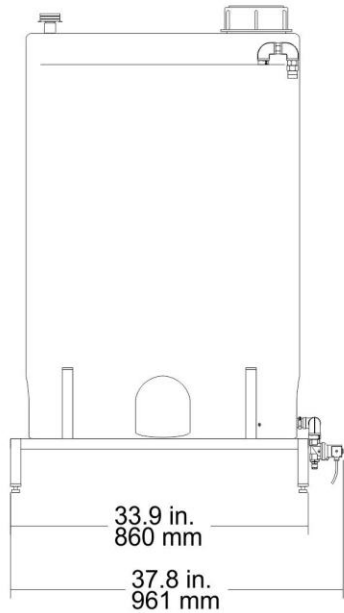

HP Series - HPRO 500 and 800
132 gallons (500 L) Tank
December, 2018

Technical specifications for high pressure hose:



Construction:

Inner tube: Polyester elastomer
 Reinforcement: Wire of tensile carbon steel with brass
 Cover: Polyurethane

Temperature range:

- 40 °C to 98 °C
 - 40 °F to 208 °F

	EX 1.1	EX 1.2	EX 1.4	EX 1.6
Item no.	107.100.000	107.101.000	107.104.000	107.105.000
Hose dimension inch	1/16"	1/8"	1/4"	3/8"
Hose inner diameter mm	1.91 ±0.1	3.35 ±0.1	6.48 ±0.15	9.65 ±0.15
Hose outer diameter mm	5.54 ±0.1	6.98 ±0.15	11.68 ±0.15	15.11 ±0.15
Max. Operating pressure	bar	100	350	325
	Psi	1,450	5,076	4,713
Min. burst pressure @20°C	bar	400	1.400	1.300
	Psi	5,801	20,305	18,855
Min. bend radius in (mm)	1.12 (30)	1.38 (35)	2.17 (55)	2.76 (70)
Nominal weight g/m	38	60	165	230

Only to be used with stainless steel hose couplings supplied by Condair


Coupling type Item no.	108.100.000	108.101.000	108.102.000	108.103.000
Tool Item no.	160.000.000	160.001.000	160.005.000	160.006.000

Properties:

- Safety thermoplastic hose to work at high operating pressures
- Excellent flexibility and flex fatigue
- Excellent resistance to chemicals and solvents
- UV and ozone resistant
- Suitable for water based hydraulics up to 70 °C
- Excellent abrasion resistance
- Low volumetric expansion for quick hydraulic response time
- Static free – 100 % electrical conductivity
- Exceeds SAE 100 R1, R2 and DIN requirements
- Min flow resistance
- Low weight per meter



HP Series -
 High-Pressure Flexible Hose
 December, 2018


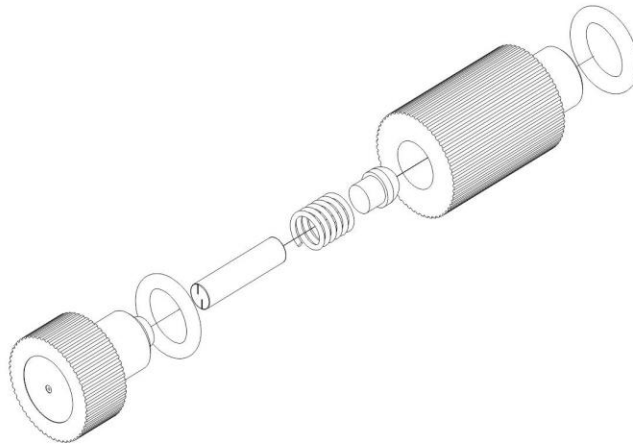


Specifications			
Nozzle			
	lbs/hr	5.5	9.9
	l/hr	2.5	4.5
Capacity			
	lbs/hr	3.74 - 5.5	7.7 - 11
	l/hr	1.7 - 2.5	3.5-5.0
Working Pressure			
	PSI	507.63 - 1015.26	507.63 - 1015.26
	Bar	35-70	35-70
	Material	316 Stainless Steel	316 Stainless Steel
Thread		12/24 UNC/2A	12/24 UNC/2A
Non-Drip Valve		Standard	Standard
Filter		Optional	Optional
Requirements for Conductivity $\mu\text{S}/\text{cm}^*$		5 < EC < 1000	5 < EC < 1000
*Lower conductivity results in longer service life and a lower risk for blockage			




Nortec HP nozzles are specifically designed to atomize water without the use of impingement pins or compressed air. Water under pressure is sprayed through an orifice which produces droplets between 5 and 10 microns in size. The nozzles are constructed from 316SS to ensure durability and long life. The nozzles also have a built-in anti-drip check valve to prevent dripping after the system has shut down.







HP Series -
High-Pressure Nozzle
December, 2018

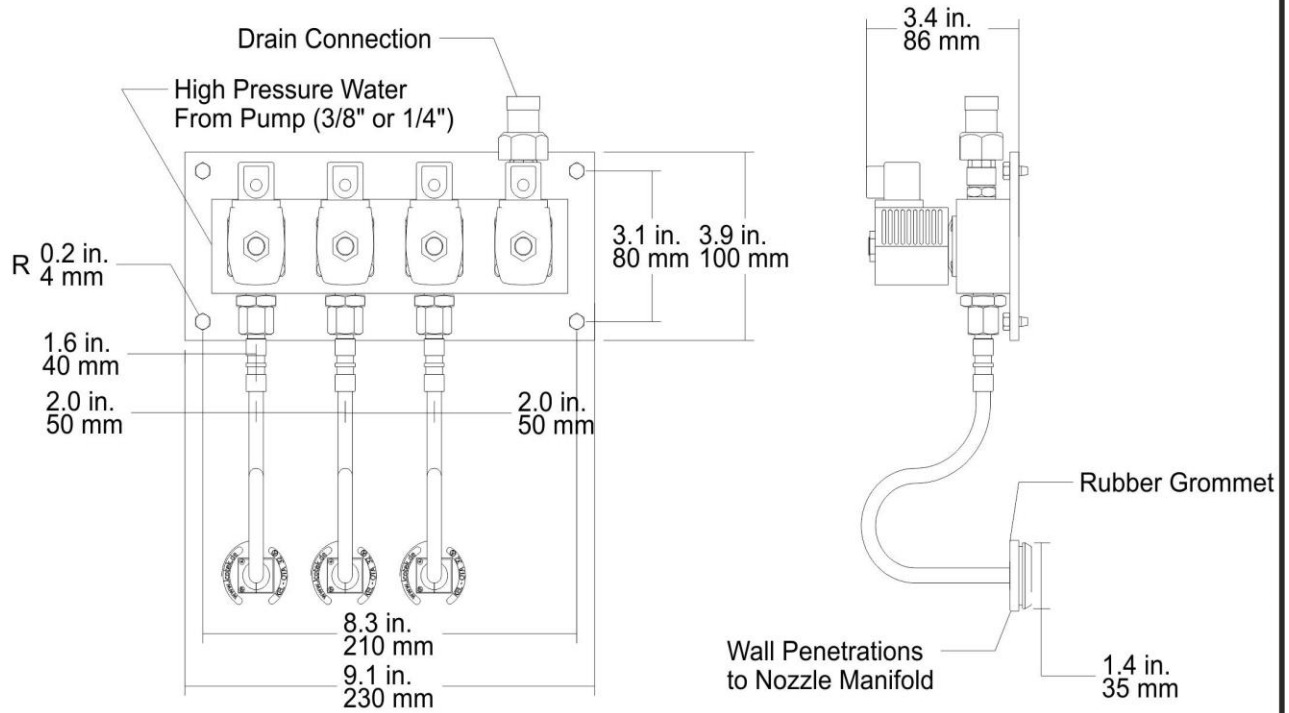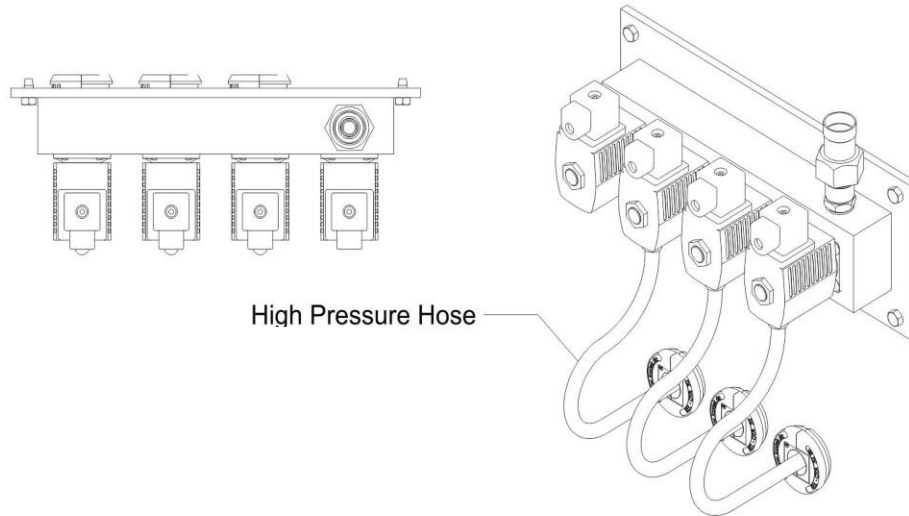


HP Series -
 Valve Block 7 Step (3 valves + flush)
 December, 2018

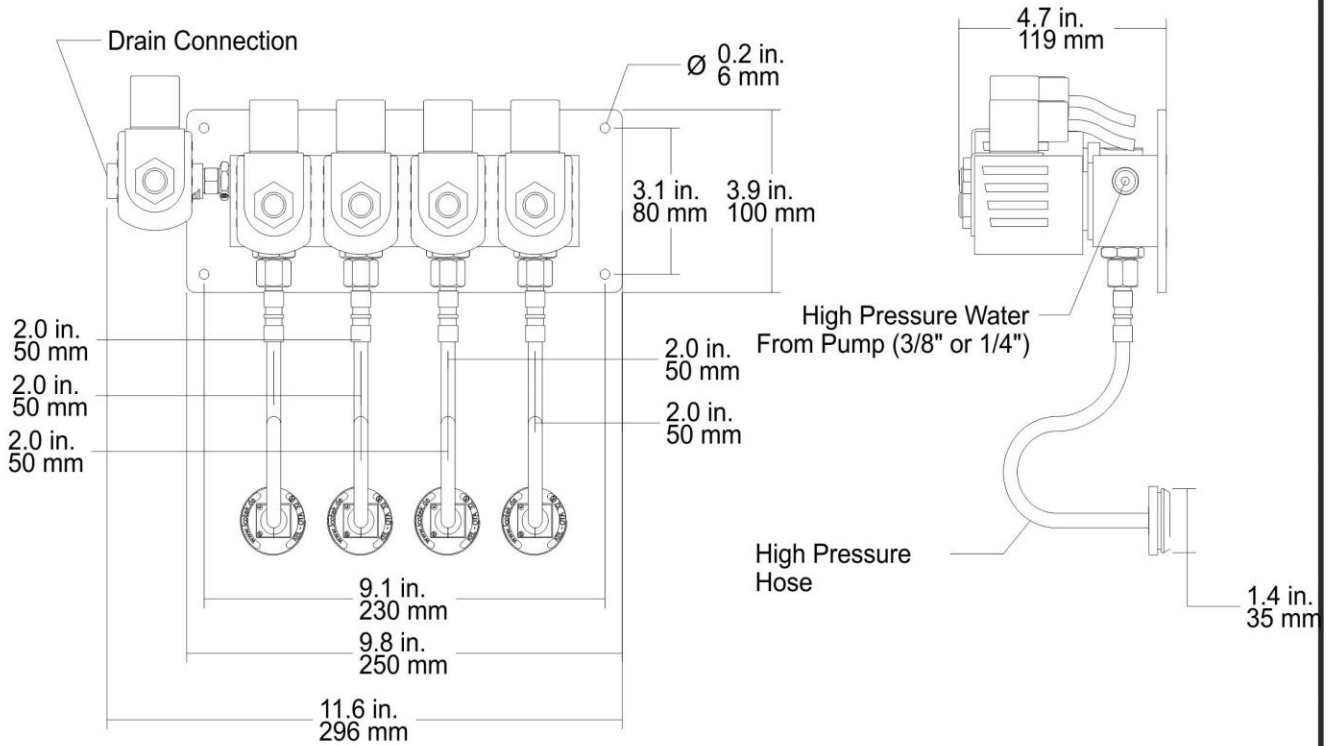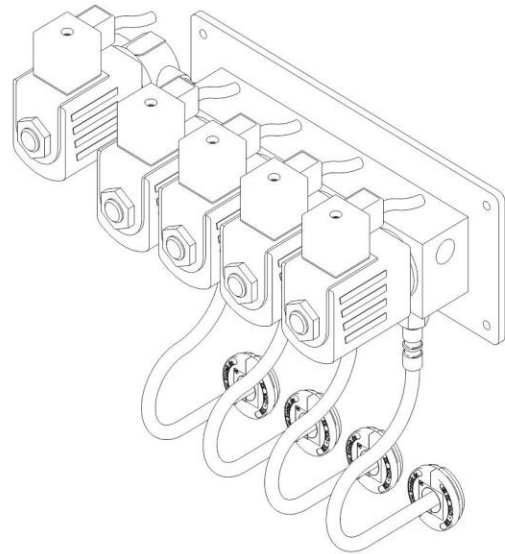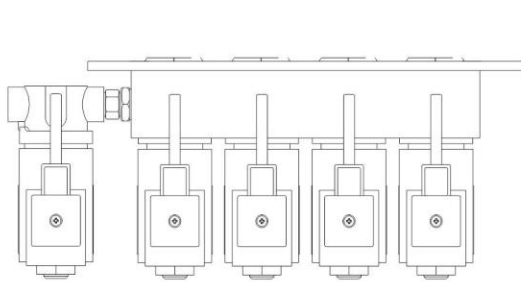


HP Series -
Valve Block 15 Step (4 valves + flush)
December, 2018

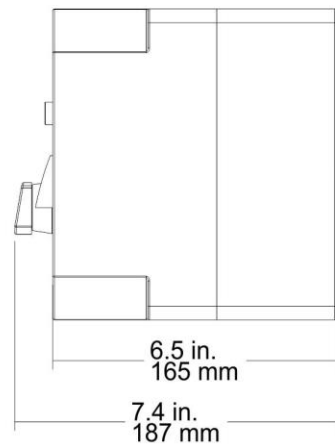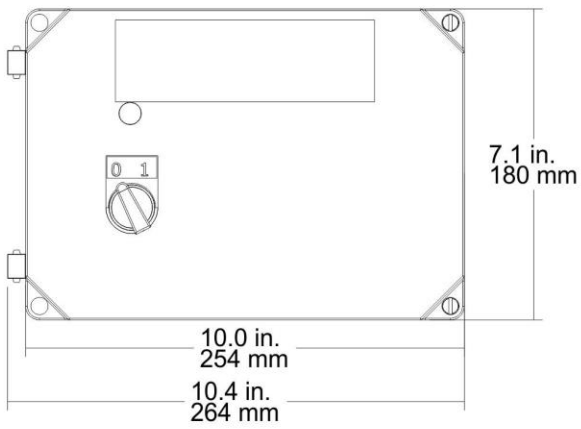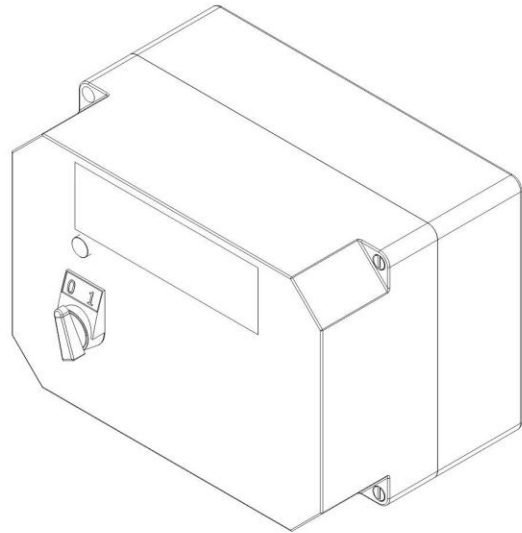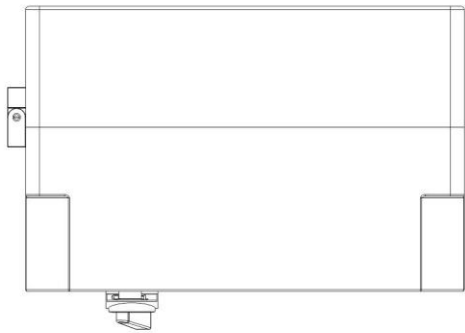

HP Series -
HP Control Box (Slave Panel)
December, 2018

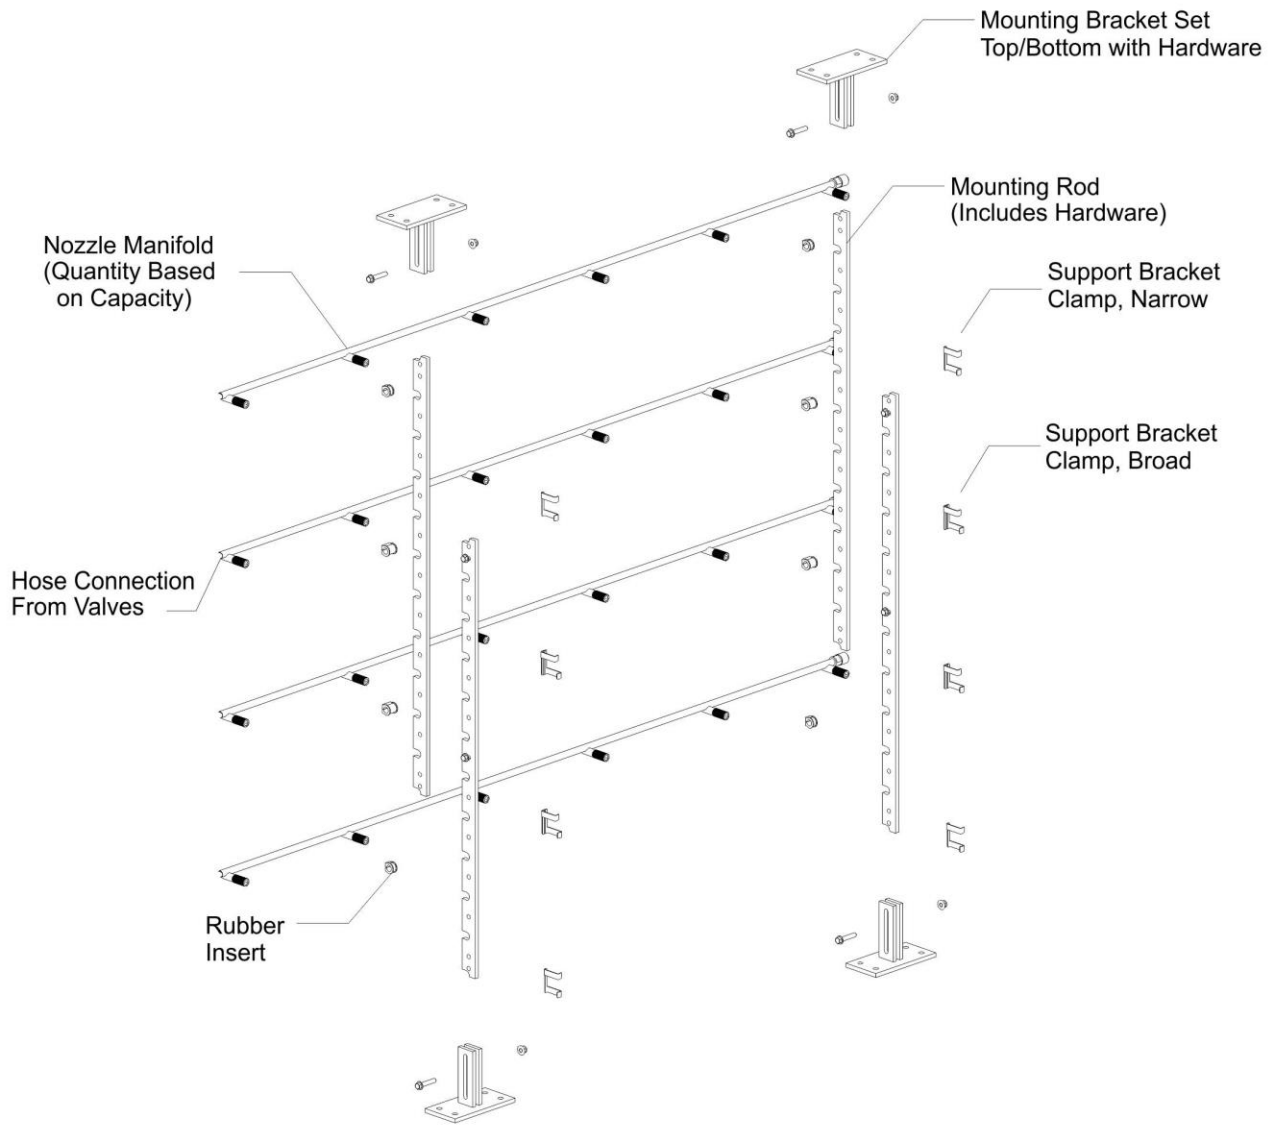


HP Series
 HP General Manifold Installation
 December, 2018

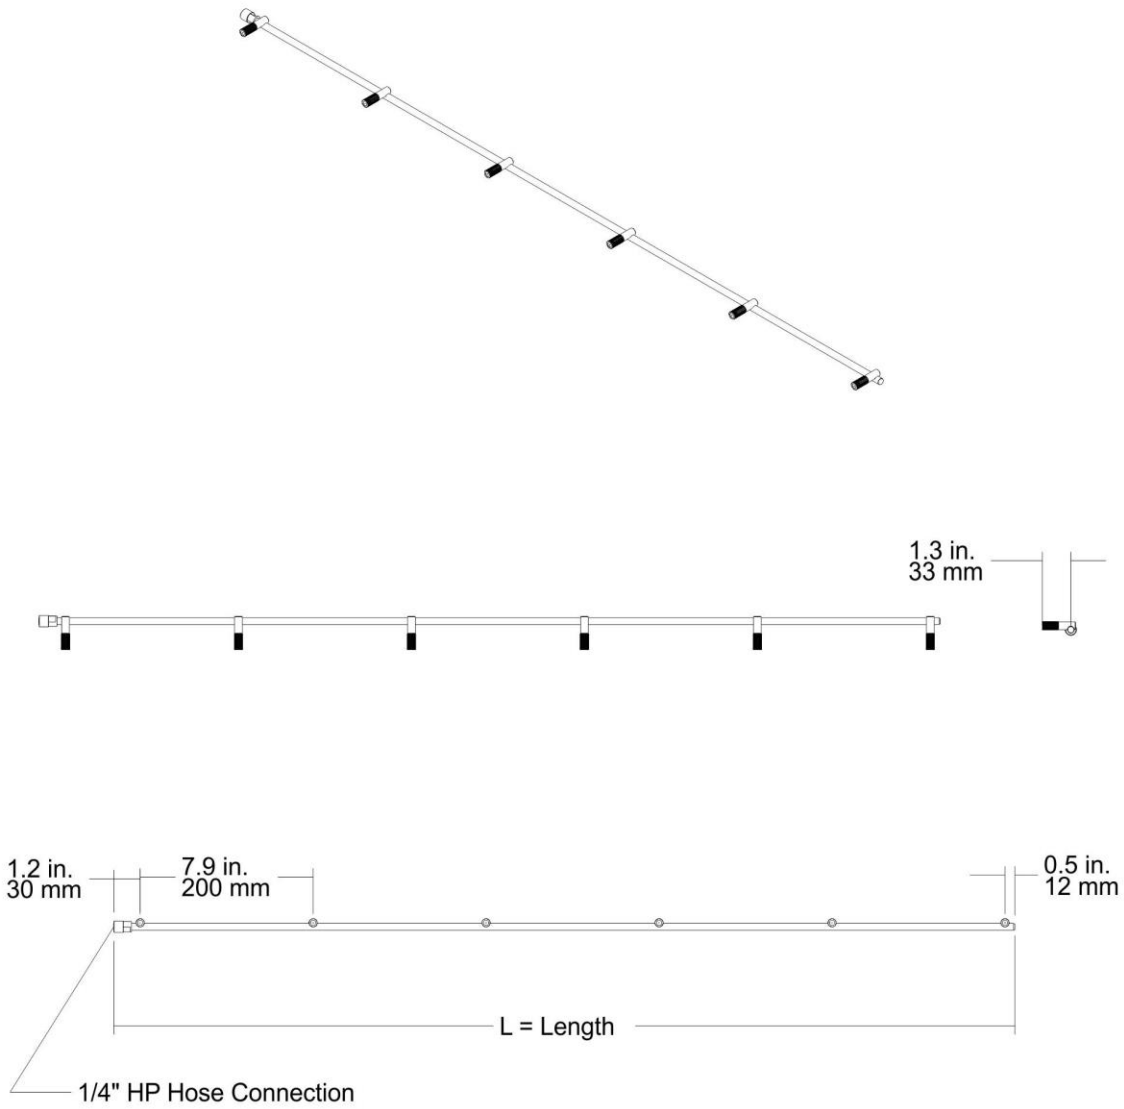

Description	Length (in)	Length (mm)	Nozzle Qty.
Base Bracket 420	19.5	495	3
Base Bracket 620	25.4	645	4
Base Bracket 820	33.1	840	5
Base Bracket 1020	41.1	1045	6



HP Series
 Nozzle Manifold Base Assembly
 December, 2018

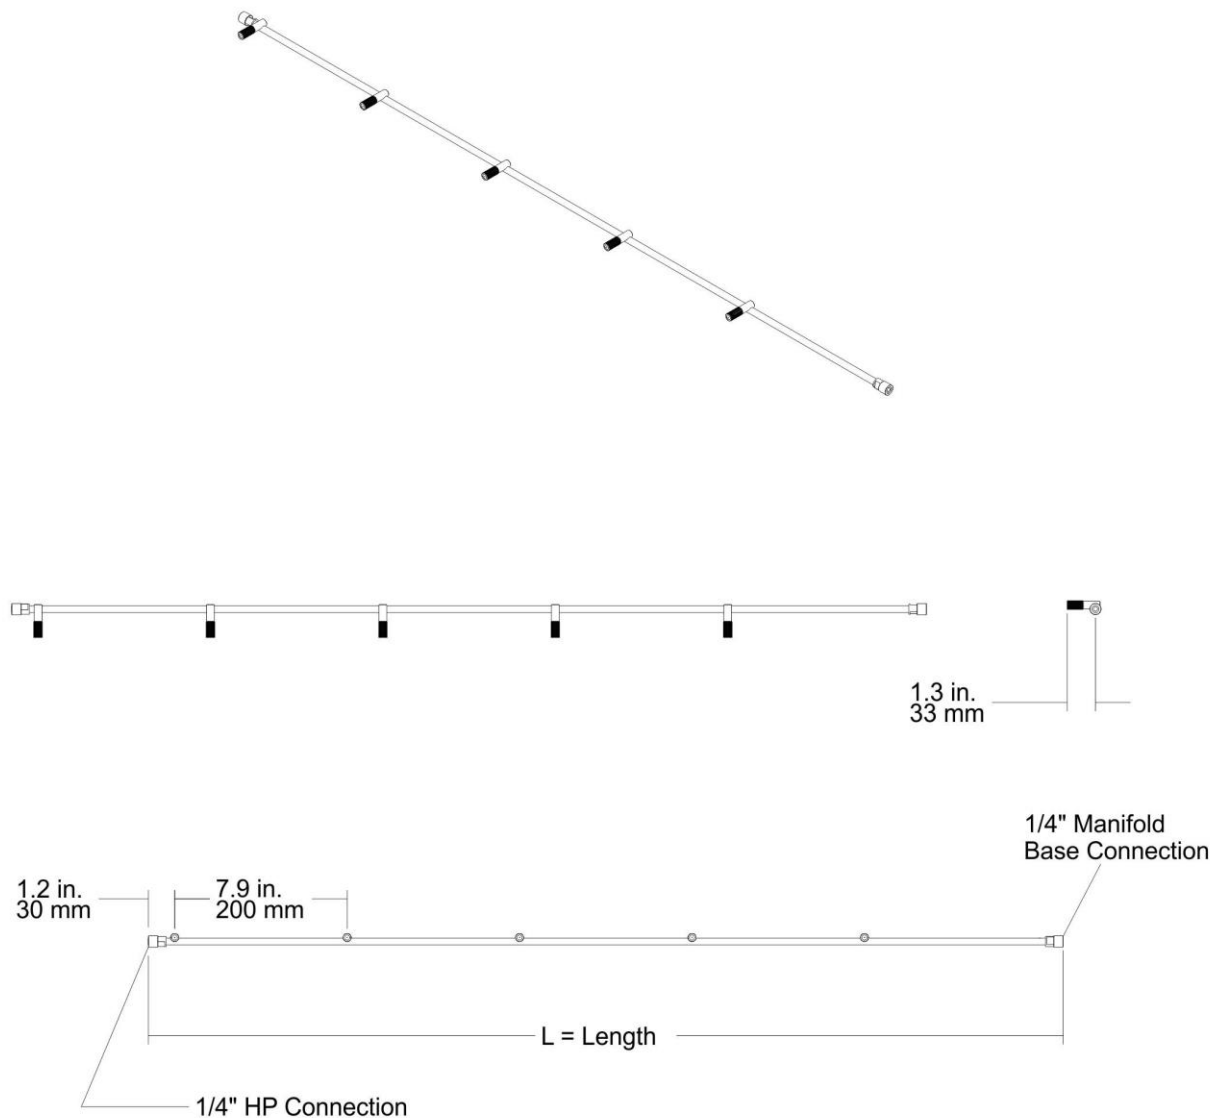


Description	Length (in)	Length (mm)	Nozzle Qty.
Extension Bracket 562	24.0	610	3
Extension Bracket 762	31.9	810	4
Extension Bracket 962	40.0	1015	5
Extension Bracket 1162	48.0	1220	6



HP Series
 Nozzle Manifold Extension Assembly
 December, 2018

0.9 in.
22 mm

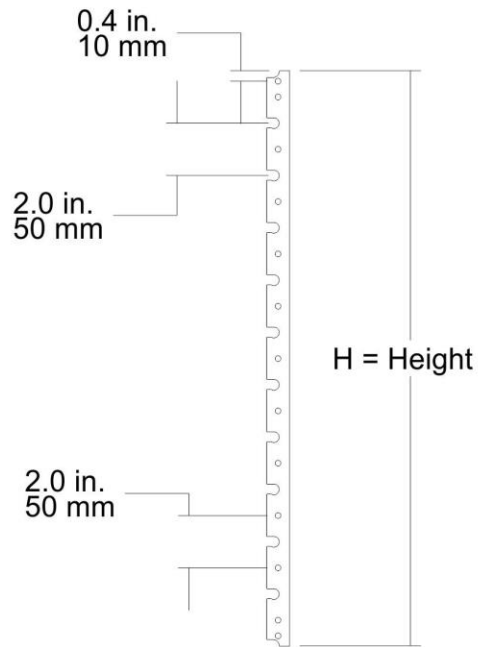

0.2 in.
5 mm

Description	Height (in)	Height (mm)
Mounting Rod, 0.5m	19.7	500
Mounting Rod, 1.0m	39.4	1000




HP Series
Nozzle Manifold Mounting Rod
December, 2018

HP Series Droplet Separator

The Droplet Separator is a single bank droplet removal system, designed to capture water within its media. Entrained water is either evaporated by the passing airflow, increasing water efficiency, or flows down towards the drain pan at the bottom of the duct section.

The droplet separator is commonly installed at a slight upstream angle (10° - 30°). When installed in this way, the top of the droplet separator is farther upstream than the bottom, and airflow drives the water downwards to the drains.

For duct sizes in between the standard sizes, the next largest droplet separator is ordered and trimmed to fit during installation.

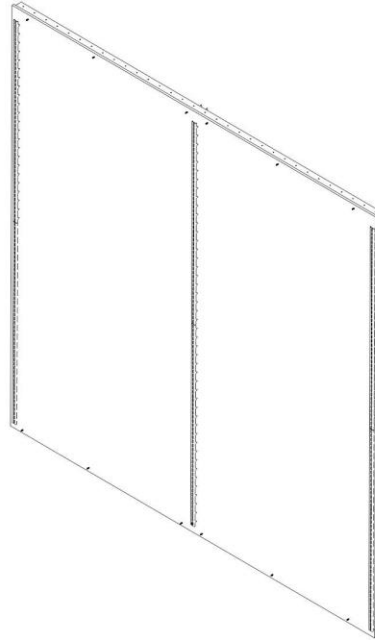

Media Specifications:

Color: White

Coatings: Antimicrobial


UV: Compatible with UV duct sterilization

Thickness: 1" nominal

Basis Weight: 1 oz. per square foot

UL Rating: 900 Class 2

Part Number	Size (ft)	
	Width	Height
2529872	4	4
2529869	4	8
2529864	4	12
2529871	8	4
2529868	8	8
2529863	8	12
2529870	12	4
2529867	12	8
2529862	12	12
2529866	16	8
2529861	16	12
2529865	20	8
2529860	20	12

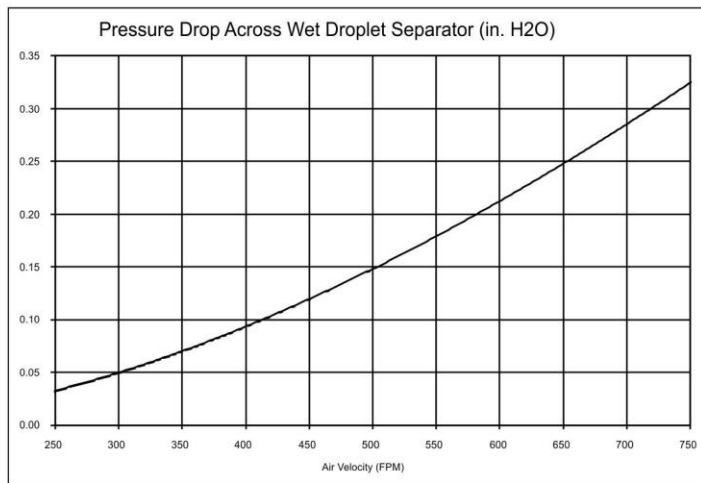

HP Series -
Mist Eliminator (Droplet Separator)
December, 2018

Water Quality Requirements

HP Series

Water Supply	Reverse Osmosis of Demineralized Water
Conductivity	5 - 50 μ S/cm
Total Dissolved Solids (TDS)	Maximum 35 mg/l
Potassium Permanganate (KMnO ₄)	Maximum 10 mg/l
Turbidity	Maximum 1 NTU
Temperature	Maximum 15°C (60°F)
Iron (Fe)	Maximum 0.2 mg/l
Manganese (Mn)	Maximum 0.05 mg/l
Maximum Hardness	Maximum 1° dH (18 ppm CaCO ₃)
Free Chlorine	Maximum 0.1 mg/l

HP RO Series

Water Supply	Potable Water
Conductivity	250 - 1000 μ S/cm
Silt Index	Maximum 3
Potassium Permanganate (KMnO ₄)	Maximum 10 mg/l
Turbidity	Maximum 1 NTU
Temperature	Maximum 15°C (60°F)
Iron (Fe)	Maximum 0.2 mg/l
Manganese (Mn)	Maximum 0.05 mg/l
Maximum Hardness	Maximum 20° dH (355 ppm CaCO ₃)
Free Chlorine	Maximum 0.1 mg/l



HP Series -
Water Quality Requirements
December, 2018

Modbus TCP/IP Communications

Model: PLC - S7- 1200

Default IP: 192.168.1.101 **Default Mask:** 255.255.255.0

Device ID: 1 **Port:** 502

Block 1 - Integers from PLC to BMS/CTS (7 Integers)

Notes:

- The PLC acts as a server in The network.
- Valve 5 will only show active on masters / slaves with 31 stage controls.
- Slave 1, Slave 2, and Slave 3 are not present on all system configurations.

Point	Type	Address	Range	Unit	Explanation
Load: Master	Integer	40001	0 - 100	l/hr	Shows the humidification load for Master.
Load: Slave 1	Integer	40002	0 - 100	l/hr	Shows the humidification load for Slave 1.
Load: Slave 2	Integer	40003	0 - 100	l/hr	Shows the humidification load for Slave 2.
Load: Slave 3	Integer	40004	0 - 100	l/hr	Shows the humidification load for Slave 3.
Status Integer 1	Integer	40005			Send as an integer. The individual bit is used as boolean as described in the following section.
Status Integer 2	Integer	40006			
Status Integer 3	Integer	40007			
Status Integer 1					
System Active	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates system activity.
Master Valve 1	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 1 for the master.
Master Valve 2	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 2 for the master.
Master Valve 3	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 3 for the master.
Master Valve 4	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 4 for the master.
Master Valve 5	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 5 for the master.
Slave 1 Valve 1	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 1 for Slave 1.
Slave 1 Valve 2	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 2 for Slave 1.
Status Integer 2					
Slave 1 Valve 3	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 3 for Slave 1.
Slave 1 Valve 4	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 4 for Slave 1.
Slave 1 Valve 5	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 5 for Slave 1.
Slave 2 Valve 1	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 1 for Slave 2.
Slave 2 Valve 2	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 2 for Slave 2.
Slave 2 Valve 3	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 3 for Slave 2.
Slave 2 Valve 4	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 4 for Slave 2.
Slave 2 Valve 5	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 5 for Slave 2.
Status Integer 3					
Slave 3 Valve 1	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 1 for Slave 3.
Slave 3 Valve 2	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 2 for Slave 3.
Slave 3 Valve 3	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 3 for Slave 3.
Slave 3 Valve 4	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 4 for Slave 3.
Slave 3 Valve 5	Boolean	0	0 - 1	0 = Closed, 1 = Open	Indicates state of valve 5 for Slave 3.
Alarm Status	Boolean	0	0 - 1	0 = OK, 1 = Alarm	Indicates the state of the alarm functions.
Unused	Boolean	0	0 - 1		Unused bit for future expansion.
Unused	Boolean	0	0 - 1		Unused bit for future expansion.



HP Series -
Modbus TCP/IP
December, 2018